




七、試驗結果

頻率 $f$ Hz	$L_{n,0}$ 1/3倍頻 dB	$\Delta L$ 1/3倍頻 dB
100	60.6	0.9
125	60.1	2.3
160	64.3	4.0
200	67.1	3.7
250	71.3	4.9
315	69.2	5.9
400	69.0	8.1
500	70.7	9.1
630	70.4	12.8
800	70.7	19.1
1000	70.9	24.0
1250	71.3	28.1
1600	70.7	32.7
2000	70.1	37.7
2500	69.1	40.0
3150	67.8	41.9

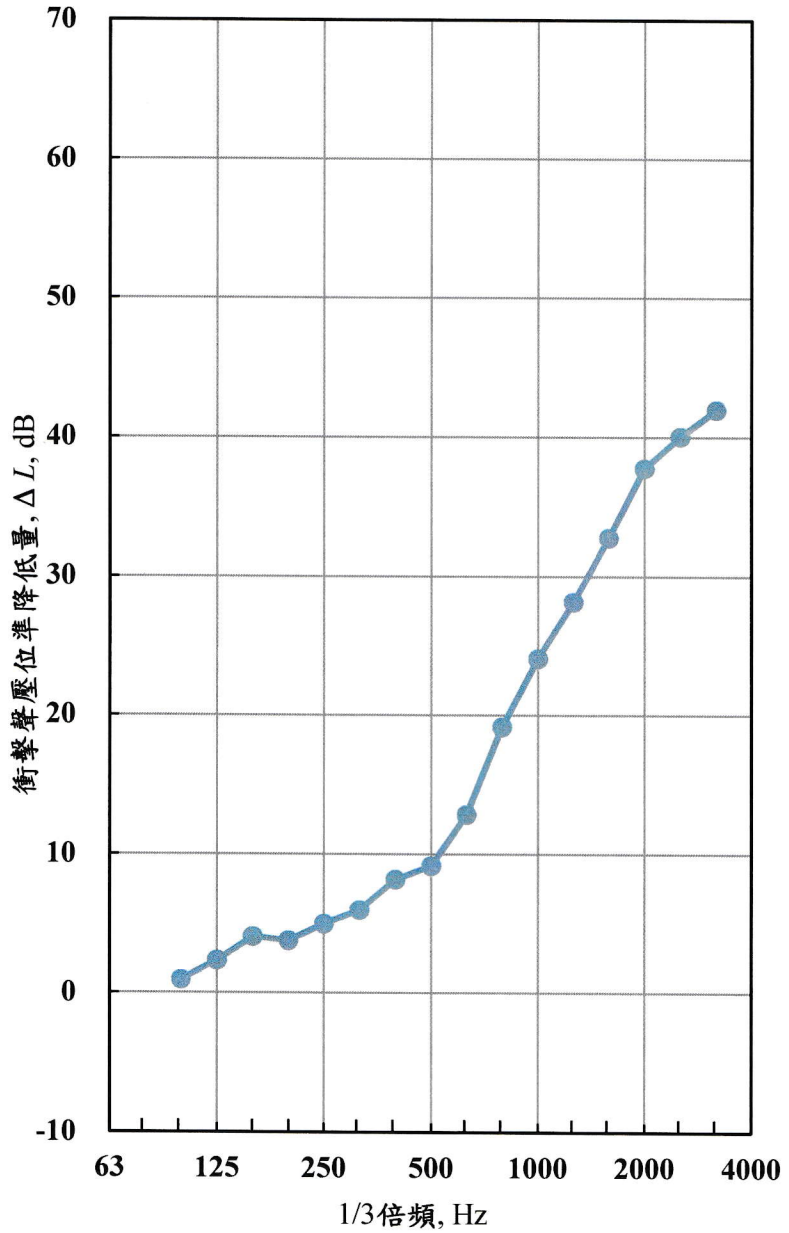

務中心章

本試驗量測標準引用CNS 15160-8:2009

依CNS 8465-2:2007宣告樓板表面材衝擊音降低量性能

$\Delta L_w = 19 \text{ dB}$

技術主管方裕鈞

試驗操作員

品質主管馮俊豪

報告簽署人